

Perception of L2 lexical stress in cochlear implant simulations


Marita Everhardt¹, Tassos Sarampalis¹, Matt Coler¹, Deniz Başkent^{1,2}, Wander Lowie¹

¹University of Groningen, ²University Medical Centre Groningen

Background

- **Cochlear implant (CI)**
 - Fine spectrotemporal detail degraded (Başkent, Gaudrain, Tamati, & Wagner, 2016)
 - Less accurate perception of F_0 & vowels
 - Perceptual hierarchy between these cues (e.g. van Zyl and Hanekom, 2013)
- **Second language (L2)**
 - Assimilation of L2 phonological patterns to those of the L1 (PAM & SLM; Best & Tyler, 2007; Flege, 1995)
 - Language specific cue-weighting patterns (e.g. Tremblay, Broersma, & Coughlin, 2018)
- **Lexical stress**
 - Signalled through prosody & vowels
 - Cue-weighting differences: Dutch vs. English (e.g. Tremblay, Broersma, & Coughlin, 2018)

Experiment

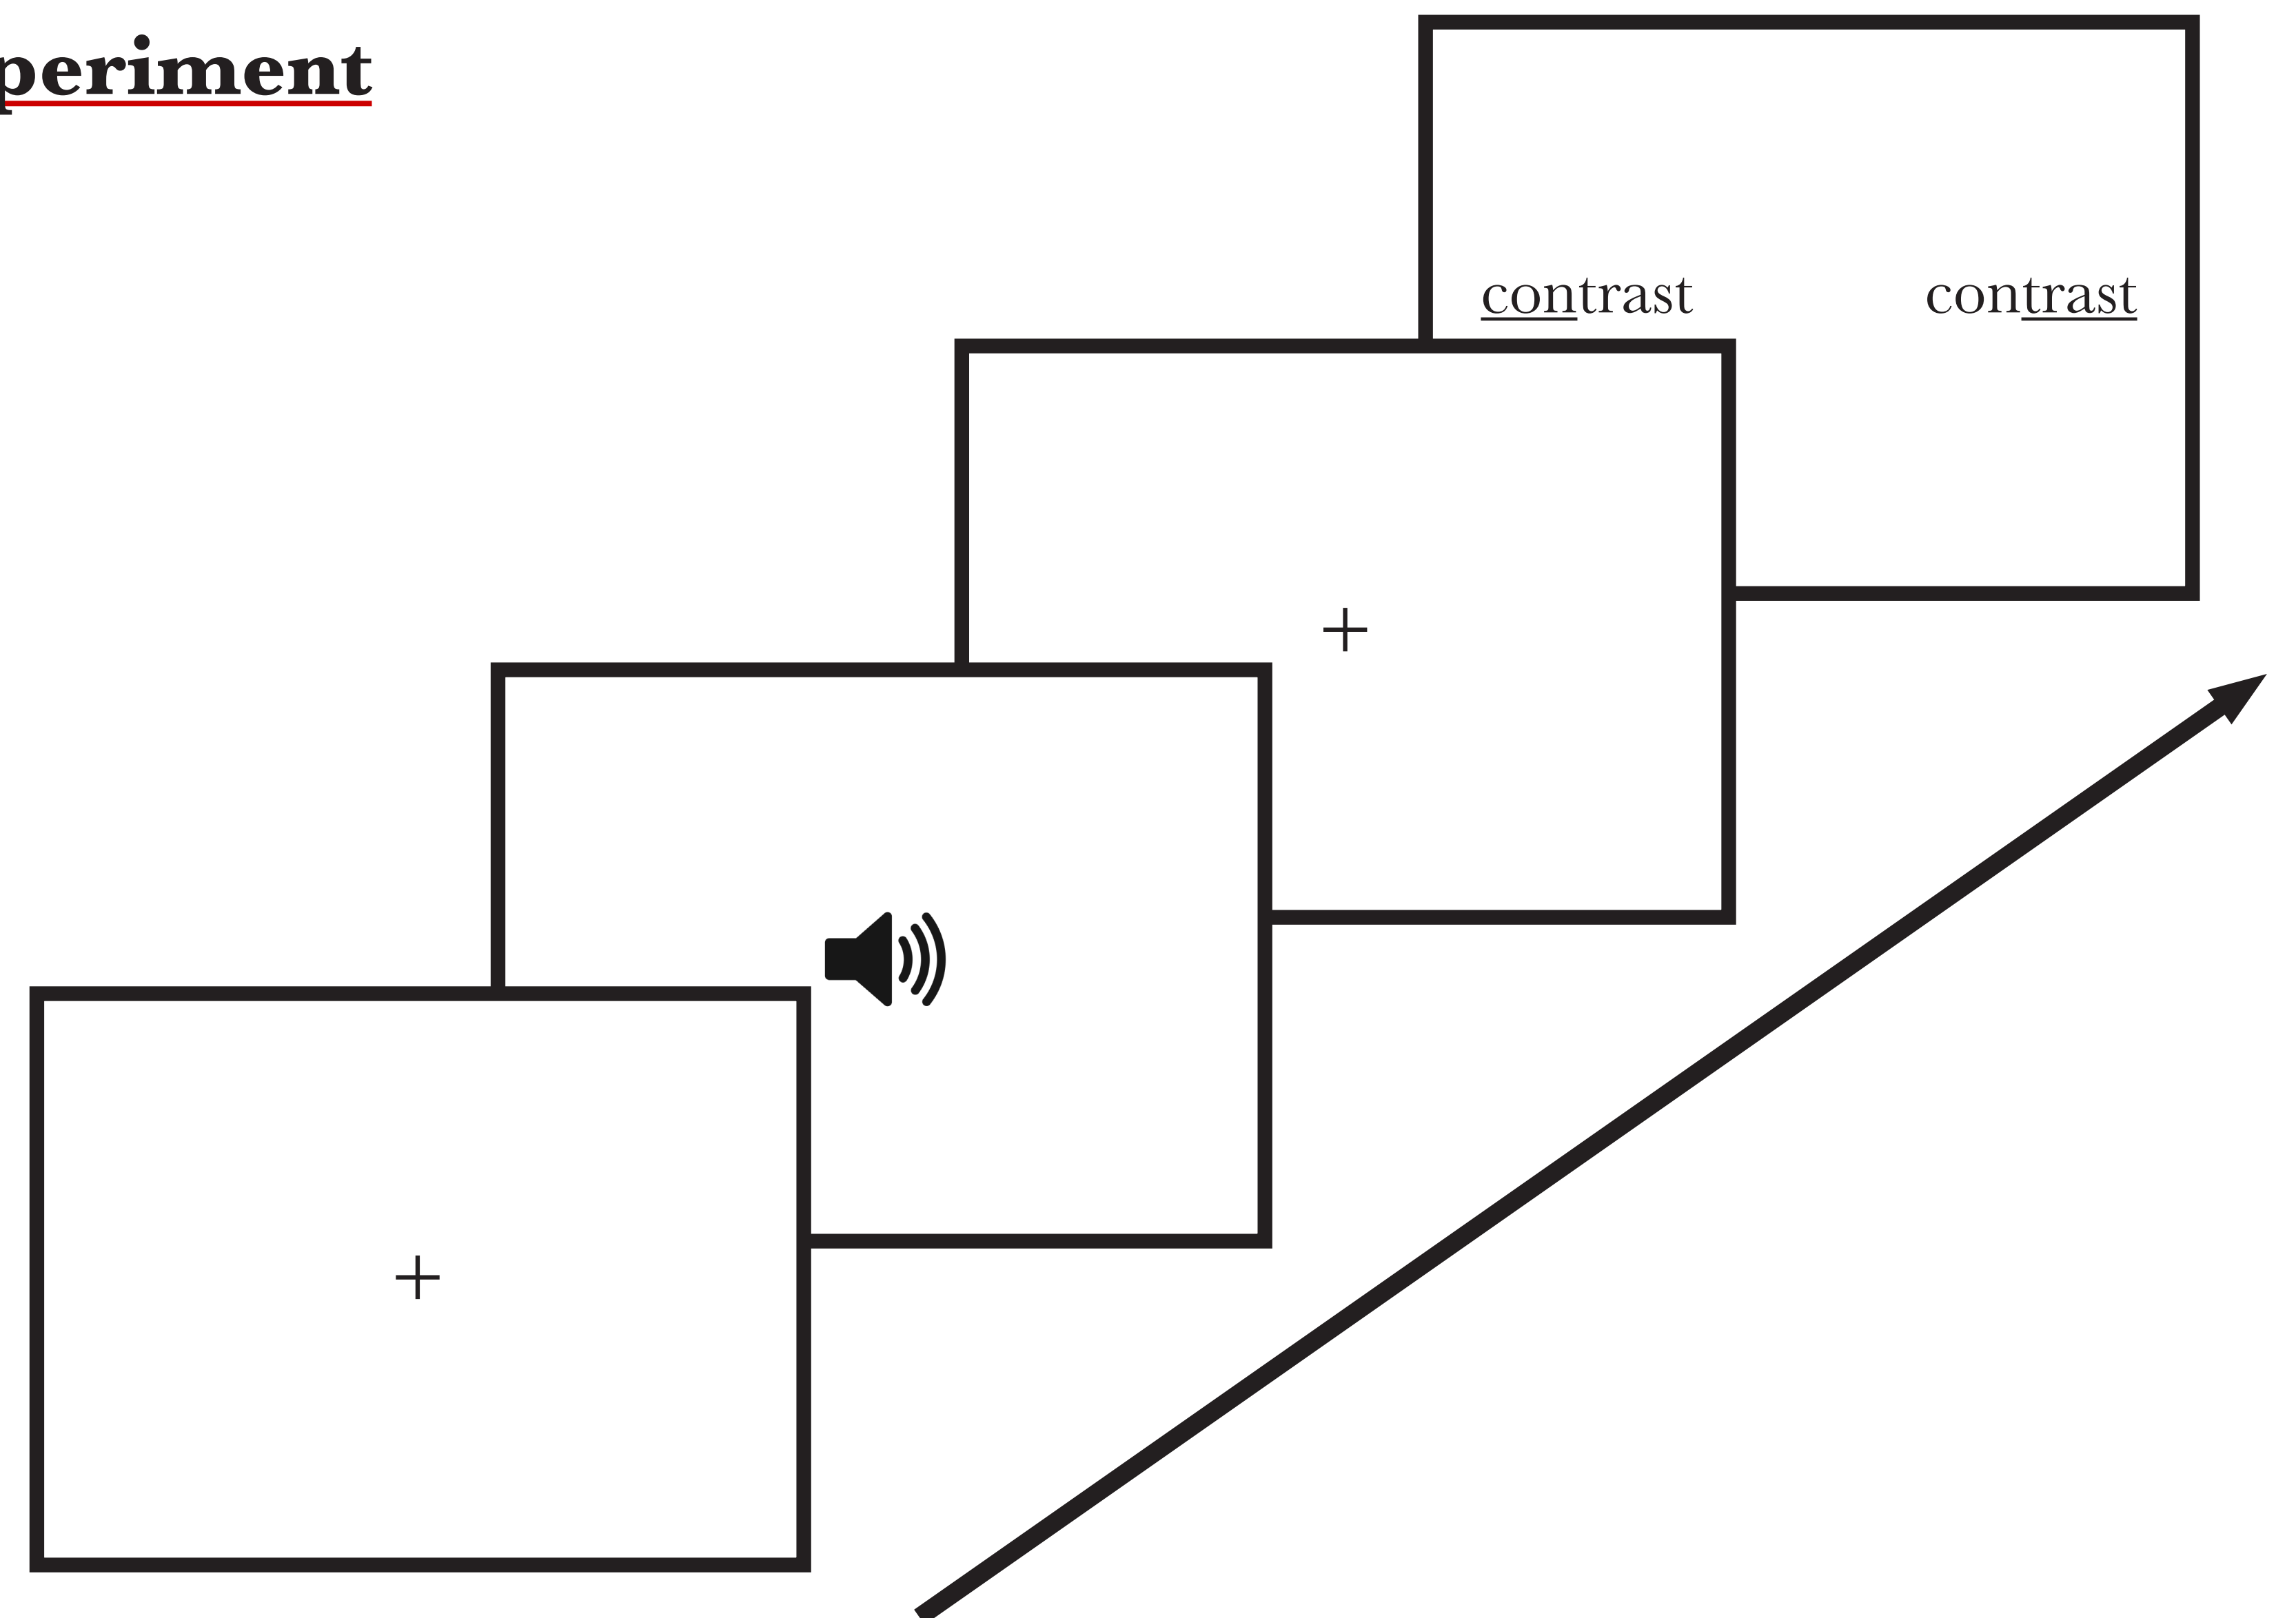

References

- Başkent, D., Gaudrain, E., Tamati, T. N., & Wagner, A. (2016). Perception and psychoacoustics of speech in cochlear implant users. In A. T. Cacace, E. de Kleine, A. G. Holt, & P. van Dijk (Eds.), *Scientific foundations of audiology: Perspectives from physics, biology, modeling, and medicine* (pp. 285-319). San Diego, CA: Plural Publishing Inc.
- Best, C. T., & Tyler, M. D. (2007). Nonnative and second-language speech perception: Commonalities and complementarities. In O.-S. Bohn & M. J. Munro (Eds.), *Language experience in second language speech learning: in honor of James Emil Flege* (pp. 13-34). Amsterdam: John Benjamins Publishing Company.
- Flege, J. E. (1995). Second language speech learning: Theory, findings, and problems. In W. Strange (Ed.), *Speech perception and linguistic experience: Issues in cross-language research* (pp. 233-277). Timonium, MD: York Press
- Tremblay, A., Broersma, M., & Coughlin, C. E. (2018). The functional weight of a prosodic cue in the native language predicts the learning of speech segmentation in a second language. *Bilingualism: Language and Cognition*, 21(3), 640-652. doi:10.1017/S136672891700030X
- van Zyl, M., & Hanekom, J. J. (2013). Perception of vowels and prosody by cochlear implant recipients in noise. *Journal of Communication Disorders*, 46(5-6), 449-464. doi:10.1016/j.jcomdis.2013.09.002

Design

- Dutch L2 learners of English
- **Categorical perception (CP)**
 - 2AFC + RT
 - Continuum matrix (5x5; F_0 vs. vowel)
 - Other cues normalised
- **Manipulations**
 - Cues (PSOLA in PRAAT)
 - CI simulations (VOCODER in MATLAB)

Analysis

- Mixed effects models (LME4 in R)
 - Logistic (GLMER; response choice)
 - Linear (LMER; RT)
- Fixed effects
 - Language (Dutch vs. English)
 - Condition (natural vs. CI simulated)
 - Continuum matrix (5x5; F_0 vs. vowel)
- Random effects (e.g. participant, word)

Predictions

